

CAIFI and CEMI Reporting

2013 CEA Analytics White Paper

Preface

This research was undertaken by Power System Solutions International Inc. (PSSI) for the New Measures Working Group of the Service Continuity Committee (SCC), a Consultative Committee on Outage Statistics in the Analytics programs of the Canadian Electricity Association. The research methodology was conducted and determined by Paul Kos, M.Sc. P.Eng., of PSSI. The content was determined by the New Measures Working Group of the SCC.

About the Service Continuity Committee

The Service Continuity Committee on Distribution Performance was developed to collect data on the overall electric distribution supply system. The data enables utilities to document the effectiveness of their service to customers and how major segments of the system have performed.

The Reporting System was inaugurated on January 1st, 1986. The system for service continuity is based on interruptions due to primary causes.

Acknowledgements

Special thanks to the New Measures Working Group of the SCC for facilitating the group: Tom Janzen, Riaz Shaikh, Falguni Shah, Paul Kuner, Bo Ji, Cesar Rivasplata.

For CEA Analytics program inquiries:

Daniel Gent
Director, Analytics
Tel: 613.230.2959
gent@electricity.ca

www.electricity.ca/analytics


Canadian Electricity Association (CEA)
Ottawa, Ontario
Canada

Published April 2013. Copyright © 2013. All rights reserved.

Aussi disponible en français.

Table of Contents

Preamble	2
Power Quality and Reliability	3
Reliability Metrics and Indices	3
1 Reliability Indices	4
1.1 Customer Based Indices	4
1.1.1 Sustained Customer Based Indices	5
1.1.2 Customer Based Indices Recognizing Momentary Interruptions	7
1.1.3 Load Based Reliability Indices	8
2 Comparison of Reliability Indices	9
3 CAIFI and CEMI	11
3.1 CAIFI	11
3.1.1 Description	11
3.1.2 Benefits	11
3.1.3 Data Collection Requirements and Incremental Effort	12
3.2 CEMI	12
3.2.1 Description	12
3.2.2 Benefits	12
3.2.3 Data Collection Requirements and Incremental Effort	13
4 Experience of Different Jurisdictions	14
4.1 Summary	14
4.2 Canadian Experience	15
4.3 USA Experience	16
4.4 Europe Experience	18
4.5 Australian Experience	19
Conclusion	20

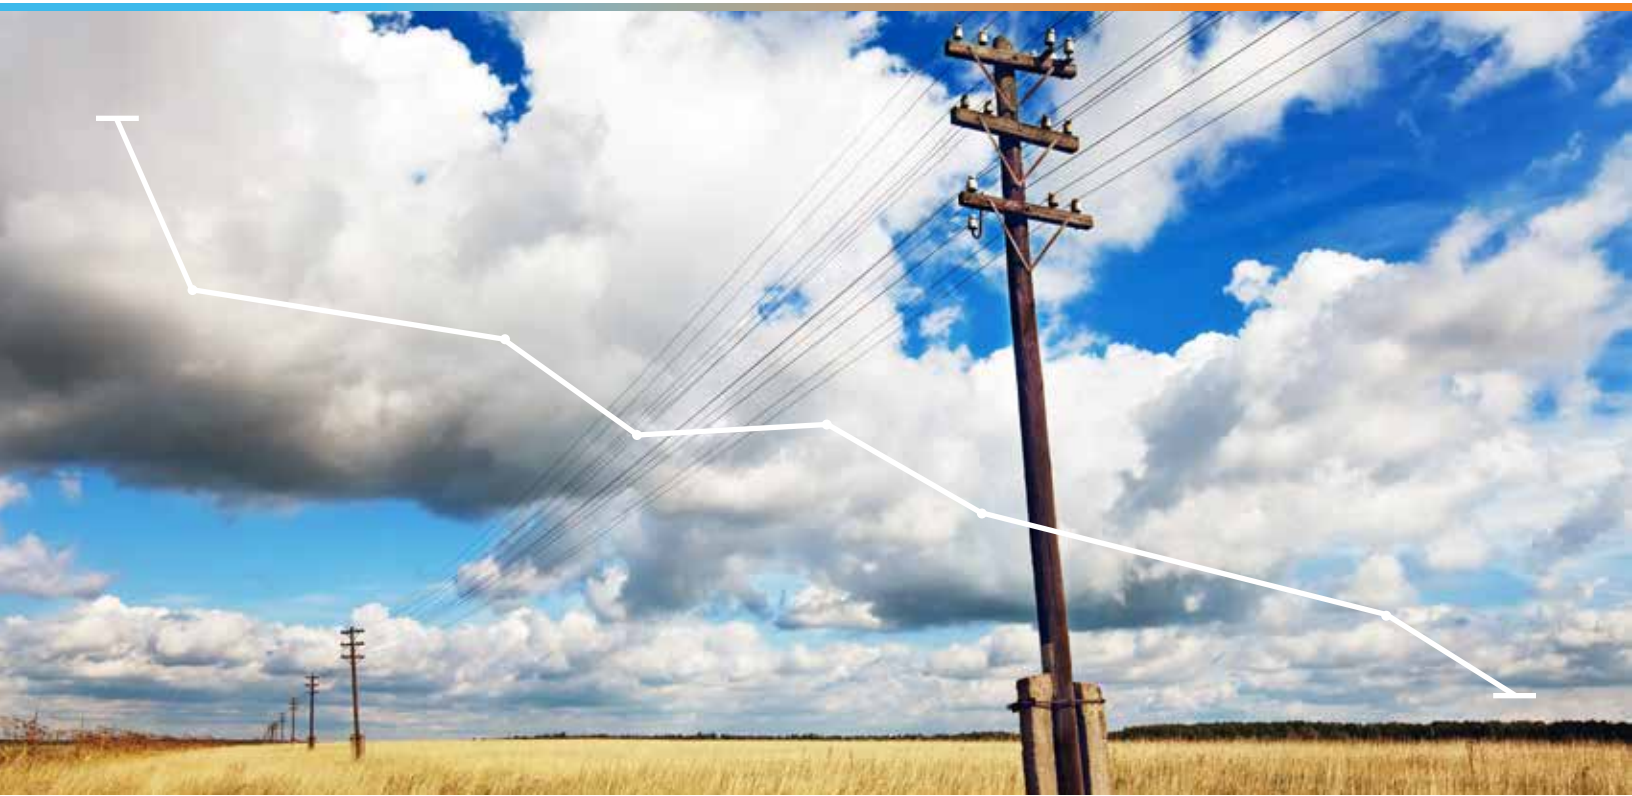

Preamble

In support of the Service Continuity Committee (SCC), a New Measures Working Group was formed to examine distribution performance indicators that are not currently used by SCC. Narrowing in on several indicators, the working group tested them in actual utility settings.

With the advent of new 'smart' technology and the expected increased flow of data to the utility world, there was a desire to explore the benefits of the CAIFI and CEMI indicators for electricity utilities, and to see how they are being used not just in Canada, but elsewhere around the world.

There are identified benefits for both indicators, but capturing the required data for each will have its own challenges for utilities as they learn to deal with not only vast amounts of data, but with data collection on outages for each individual customer. In turn, such challenges may not be currently possible for some utilities as their internal systems may be incompatible. If that is the case, the utility in question would incur additional costs to make adjustments for capturing the required data.

The intent of this document is not to promote CAIFI and CEMI, but to explore their effectiveness for utilities' to improve reliability, how to leverage them and identify the challenges to the readers.

Power Quality and Reliability

As consumers of electricity, electrical customers are in a broad sense concerned with the electrical supply capability to meet the requirements of their electrical equipment. Such capability is typically expressed in terms of power quality and supply reliability.

Power quality typically refers to the quality of supply voltage as measured against a perfect sinusoidal wave with constant and correct amplitude and with constant and correct frequency. Deviations from such target are referred to as harmonic distortion, frequency deviation, voltage sag or flicker, voltage

swell or spike. Power quality is addressed by number of standards such as ANSI C84.1, EU HD 472 S1, IEEE Std. 446, “CBEMA curve” and “ITIC curve” to name a few.

Supply reliability typically refers to complete cessation of power with either momentary (less than five minutes) or sustained duration.

While power quality deviations can have significant consequences that may compare to or exceed those resulting from complete loss of supply, this White Paper focuses only the latter, namely the reliability.

Reliability Metrics and Indices

Distribution reliability relates primarily to equipment outages and customer interruptions. While the equipment reliability is of primary interest only to utility personnel concerned with planning operation and maintenance of the distribution systems, the reliability as seen by customers has a broader reach to utility management, customers and regulators since it is used to measure performance of the

distribution utility. Indeed, reliability indices such as SAIFI (System Average Interruption Frequency Index) and SAIDI (System Average Interruption Duration Index) are commonly used in PBR (Performance Based Regulation) based tariffs. As such, these indices often directly affect the corporate rate of return.





1 Reliability Indices

Over the years, a relatively large number of “de facto standard” reliability indices were developed by industry and academia to measure the power system reliability from the end user point of view. Many of these indices were formally adopted in the official standards such as IEEE 1366 and others.

The reliability indices are effectively statistical aggregations (averages, expected values, etc.) for a well-defined set of loads or customers. Most common reliability indices can be divided as either customer based or load based. The same index can often be also calculated for only momentary or only sustained outages.

Next two sections present a summary of common reliability indices and their definitions.

1.1 Customer Based Indices

The definitions of common customer based reliability indices are summarized in this section. These indices are referred to as “customer based” since they do not appropriately distinguish between customers. For example, the industrial customer with demand in MW range is accounted for in the same manner as a residential customer with demand in range of a few kW.

1.1.1 Sustained Customer Based Indices

Most common customer based reliability indices recognize, by definition, only the sustained customer outages. Definition of sustained outages differs from jurisdiction to jurisdiction with respect to the considered maximum duration. Typically, the maximum duration ranges between one and five minutes.

The definitions of reliability indices for sustained outages are summarized in this section.

1.1.1.1 Availability

Availability is the most basic of the reliability indices. It is the probability of a customer being energized. It is typically measured in percent or on per unit basis. Unavailability is the reverse of Availability, namely the probability of not being energized. Mathematically, this is given in:

$$Availability = \frac{\text{Time energized}}{\text{Total time period}}$$

$$Unavailability = \frac{\text{Time not energized}}{\text{Total time period}}$$

Availability and Unavailability are typically not used directly in the utility performance reporting systems. Instead, the ASAI or ASUI indices are used as described below.

1.1.1.2 SAIFI: System Average Interruption Frequency Index

The System Average Interruption Frequency Index (SAIFI) indicates how many sustained interruptions an average customer will experience over a predefined period of time, typically a year. Mathematically, this is given in the equation below:

$$SAIFI = \frac{\sum \text{Total Number of Customers Interrupted}}{\text{Total Number of Customers Served}} \text{ [occ/year]}$$

1.1.1.3 SAIDI: System Average Interruption Duration Index

System Average Interruption Duration Index (SAIDI) is a measure of how many interruption hours an average customer will experience during a predefined period of time, typically a year. It is also commonly expressed in minutes per year.

$$SAIDI = \frac{\sum \text{Total Customer Interruption Durations}}{\text{Total Number of Customers Served}} \text{ [hours/year]}$$

1.1.1.4 CAIFI: Customer Average Interruption Frequency Index

The Customer Average Interruption Frequency Index (CAIFI) indicates how many sustained interruptions an affected customer will experience over a predefined period of time, typically a year. This index differs from SAIFI only by the numerator: instead of using total number of customers served, the frequency is expressed in terms of customers experiencing at least one interruption per year.

Mathematically, this is given in the equation below:

$$CAIFI = \frac{\sum \text{Total Number of Customer Interruptions}}{\text{Total Number of Customers Interrupted}} \text{ [occ/year]}$$

1.1.1.5 CAIDI: Customer Average Interruption Duration Index

Customer Average Interruption Duration Index (CAIDI) is a measure of how long an average interruption will last. This index differs from SAIDI only by the numerator: instead of using total number of customers served, the duration is expressed in terms of total number of customer – interruptions. As such, CAIDI is a measure of restoration time.

$$CAIDI = \frac{\sum \text{Total Customer Interruption Durations}}{\text{Total Number of Customer Interruptions}} \text{ [hours/occ]}$$

1.1.1.6 ASAI: Average Service Availability Index

Average Service Availability Index (ASAI) is the customer-weighted availability of the system or, from a customer's point of view, the fraction of time (percentage of time) an average customer received power.

$$ASAI = \frac{\text{Customer hours of available service}}{\text{Customer hours demanded}} \times 100 \text{ [%]}$$

ASUI is complimentary index defined as 1-ASAI.

1.1.1.7 CTAIDI: Customer Total Average Interruption Duration Index

Customer Total Average Interruption Duration Index (CTAIDI) represents the total time in the reporting period that customers who actually experienced an interruption were without power. This index is complimentary to CAIDI and is similarly calculated, except that those customers with multiple interruptions are counted only once.

$$CTAIDI = \frac{\sum \text{Total Customer Interruption Durations}}{\text{Total Number of Customers Interrupted}} \text{ [hours/occ]}$$

1.1.1.8 CEMI_n: Customers Experiencing Multiple Interruptions

Customers Experiencing Multiple Interruptions (CEMI_n) indicates the ratio of individual customers experiencing n or more sustained interruptions to the total number of customers served.

$$CEMI_n = \frac{\text{Total Number of Customers Experiencing } n \text{ or more interruptions}}{\text{Total Number of Customers Served}} \text{ [occ/year]}$$

1.1.1.9 CELID_t: Customers Experiencing Long Interruption Durations

The Customers Experiencing Long Interruption Durations Index (CELID_t) indicates the ratio of individual customers that experience interruptions with durations longer than or equal to a given time. That time is either the duration of a single interruption (s) or the total amount of time (t) that a customer has been interrupted during the reporting period. Caution has to be exercised when interpreting the CELID_t index since sometimes the t is considered as cumulative and sometimes as pertaining to individual outages.

$$CELID_t = \frac{\text{Total Number of Customers Experiencing interruptions longer than } t}{\text{Total Number of Customers Served}} \text{ [occ/year]}$$

1.1.2 Customer Based Indices Recognizing Momentary Interruptions

Several common reliability indices recognize the momentary interruptions. The representative listing of most common indices is shown in this section.

1.1.2.1 MAIFI: Momentary Average Interruption Frequency Index

The Momentary Average Interruption Frequency Index (MAIFI) indicates the average frequency of momentary interruptions. It is analogous to SAIFI except that it counts only the momentary outages.

$$MAIFI = \frac{\sum \text{Total Number of Customer Momentary Interrupted}}{\text{Total Number of Customers Served}} \text{ [occ/year]}$$

1.1.2.2 MAIFI_e: Momentary Average Interruption Event Frequency Index

The Momentary Average Interruption Event Frequency Index (MAIFI_e) indicates the average frequency of momentary interruption events. This index counts multiple momentary interruptions related to the same event as one. This index does not include the momentary outages related to the events immediately preceding a sustained interruption as such events are reflected in SAIFI.

$$MAIFI_e = \frac{\sum \text{Total Number of Customer Momentary Interrupted}}{\text{Total Number of Customers Served}} \text{ [occ/year]}$$

1.1.2.3 CEMSMI_n: Customers Experiencing Multiple Sustained and Momentary Interruptions

Customers Experiencing Multiple Sustained and Momentary Interruptions (CEMSMI_n) is similar to CEMI_n except that it includes both momentary and sustained outages.

$$CEMSMI_n = \frac{\sum \text{Customer Experiencing More than } n \text{ Combined Momentary and Sustained Outages}}{\text{Total Number of Customers Served}} \quad [\text{occ/year}]$$

1.1.3 Load Based Reliability Indices

Two of the oldest distribution reliability indices weigh customers based on connected kVA as opposed to weighting each customer equally. These indices precede the customer based indices since in the past utilities did not have knowledge of exactly how many customers are connected to each distribution transformer but knew the size of the transformer. With development of customer information systems (CIS), the customers can be readily identified with each feeder and use of load based reliability indices dropped in favor of customer based indices.

1.1.3.1 ASIFI: Average System Interruption Frequency Index

The calculation of the Average System Interruption Frequency Index (ASIFI) is based on load rather than number of customers affected. ASIFI is sometimes used to measure distribution performance in areas that serve relatively few customers or that have relatively large concentrations of industrial or commercial customers.

Theoretically, in a system with homogeneous load distribution, ASIFI would be the same as SAIFI.

$$ASIFI = \frac{\sum \text{Connected kVA Load Interrupted}}{\text{Total Connected kVA Served}} \quad [\text{occ/year}]$$

1.1.3.2 ASIDI: Average System Interruption Duration Index

The calculation of the Average System Interruption Duration Index (ASIDI) is based on load rather than customers affected.

$$ASIDI = \frac{\sum \text{Connected kVA Hours Interrupted}}{\text{Total Connected kVA Served}} \quad [\text{hours/year}]$$



2 Comparison of Reliability Indices

The use of distribution reliability indices can be loosely divided into three overlapping areas, namely:

1. Distribution system planning
2. Benchmarking
3. Regulatory process and Performance Based Regulation (PBR)

Since ideally the objectives of each of these areas of reliability indices use are similar, namely the optimization of investment and operating expenditures to maximize reliability to utility customers, the comparison of the indices can focus on the planning aspect without any loss of generality.

The two most reported distribution reliability indices are SAIFI and SAIDI. These indices are complimentary; the former reflects frequency of power outages, the latter the average duration. Both are expressed in terms of an average customer. SAIFI and SAIDI are good set of indices to use when prioritizing the expenditures; however the means of how to improve each differs. Fortunately, the actions used to improve reliability either improves both indices or at least does not affect adversely one of them.

The two most common ways to improve SAIFI is to reduce the number of overall sustained outage events (such as effective reclosing) and to reduce the number of customers affected by such events (such as by sectionalizing). All else being equal, a reduction in SAIFI will also reduce the SAIDI since the total customer minutes of interruption will be reduced.

The most common way of reducing the SAIDI is to reduce the restoration time. Such improvement will not affect the SAIFI. As discussed above, a reduction in the frequency of events resulting in sustained outages or a reduction in the number of affected customers during such events also reduces SAIDI.

Common criticism of SAIFI and SAIDI use alone revolves around targeting expenditures. Often, the

greatest improvement in SAIFI and SAIDI can be achieved in urban, high density areas where the reliability may already be adequate for customer needs. In extreme circumstances, the funds would be diverted from low density areas to high density areas, exposing customers in low density areas to an unacceptable level of sustained outages and to long restoration times.

The concern described above also often relates to levels of customer satisfaction which is typically non-linear. Further improvement of already satisfactory levels of reliability in high density areas may not result in further improvement in customer satisfaction while the dissatisfaction of customers experiencing large number and/or prolonged outages in low density area remains high or even increases.

Another issue arises from pitting SAIFI against SAIDI. If the customer interruption cost were increasing proportionately with duration, more specifically, if customer impact of interruption lasting twice as long would equal double the cost, there would be no difference between improvements in SAIFI and SAIDI. However, should the customer cost of interruption be reasonably independent of duration (at least within a given range), improvement in SAIDI caused solely by a reduction in interruption duration will be less valuable than the improvement in SAIFI. In extreme cases, it may not lead to any appreciable improvement in customer utility.

Use of CAIDI, although prevalent, is often problematic. CAIDI is typically seen as a measure of efficiency when responding to outages. All else being equal, a reduction in restoration time will reduce CAIDI. Problems arise when SAIFI does not remain constant, more specifically, when SAIFI improves more quickly than SAIDI. Since CAIDI is simply SAIDI divided by SAIFI the CAIDI can actually increase while both SAIFI and CAIDI decrease. For example, should SAIFI improve from 2 occ per year to 1 occ per year (a rather dramatic improvement), and SAIDI

improves from 100 minutes to 90 minutes, CAIDI will increase from 50 minutes to 90 minutes. It is true that in this example, the average response time for affected customers actually increased, but the system as a whole is certainly more reliable.

As demonstrated, CAIDI is best used as a supplementary index that augments SAIFI and SAIDI.

Similar to SAIFI and SAIDI, MAIFI will also drive investment towards the highest density areas where reliability may be already satisfactory. Furthermore, in its most basic form, MAIFI will discourage investment in automated switching schemes, since these will typically lead to an increased number of momentary outages to customers (i.e. will only reduce the frequency and duration of sustained outages).

MAIFI addresses the above concern to some degree by eliminating momentary outages preceding the sustained outage from inclusion and by focusing on the event rather than on each momentary outage. However, the association of momentary outages with events requires additional considerable effort during data collection and processing.

CEMI and CAIFI address some of the concerns with SAIFI and SAIDI expressed above. More specifically, by focusing only on the customers experiencing outages, it inherently addresses the area with lower reliability. Since this White Paper is focused on the need for collecting data required for reporting CAIFI and CEMI, their benefits and shortcomings are discussed in specific sections below.

Strengths and weaknesses of ASIFI and ASIDI indices stem from their focus on size of interrupted load. As such, they favor industrial and commercial customers over residential. While such focus may be supported by the results of studies investigating customer costs resulting from power supply interruptions, it is typically not politically acceptable. Consequently, these indices are often used only on feeders with predominantly industrial or commercial load.



3 CAIFI and CEMI

As previously stated, CEMI and CAIFI address some of the concerns with SAIFI and SAIDI and other indices described in this Report.

3.1 CAIFI

3.1.1 Description

CAIFI is a measure of the frequency of power supply interruptions for customers who experience interruptions. CAIFI is similar to SAIFI except for the denominator that comprises only customers who experienced at least one interruption. As such, the best possible value attainable is 1 (as opposed to 0 for SAIFI). In situations where each customer experiences at least one outage, CAIFI would in fact equal SAIFI. CAIFI was defined in Section 1.1.1.4.

3.1.2 Benefits

The major benefit of CAIFI stems from its focus on customers who experience outages, namely the poorly performing feeders typically found in the low density parts of a service area.

CAIFI shortcoming revolves around its behavior when reliability on some feeders is improved to the point that a number of customers do not experience any outages at all. In this case, assuming all else being equal, the customers are no longer counted in the denominator, and CAIFI can actually increase. The only way to show that the reliability actually increased is to show a drop in SAIFI. In fact, the CAIDI by itself does not show whether its reduction was due to an improvement in reliability or by an increase in the number of customers experiencing at least one interruption.

CAIFI displays highly desirable information pertaining to feeders that experience outages. However, to properly interpret any trends, it has to be augmented by the information on trend in a number of customers that experience at least one interruption. Such information is contained in the CEMI index, discussed later on in this White Paper.

While CAIFI is valuable supplementary information, it does not replace the need for SAIFI and SAIDI. Rather, it provides additional insight into the performance of feeders with lower reliability. Care has to be exercised to interpret properly trends in CAIFI since they can be counterintuitive.

3.1.3 Data Collection Requirements and Incremental Effort

The CAIFI data collection requirement is similar to that of SAIFI except that the identity of the interrupted customers has to be retained in the collection system to determine which customers were interrupted at least once over the reporting period. With the proliferation of CIS and its connectivity to the reliability data collection systems, this requirement is not prohibitive since the information will be available and only a programming change will be required.

It should also be noted that CAIFI can be calculated from $CEMI_n$ for $n=1$ and SAIFI as follows:

$$CAIFI = \frac{SAIFI}{CEMI_1} \text{ [occ/year]}$$

3.2 CEMI

3.2.1 Description

CEMI, as its name suggests, is a measure of how many customers experience n interruptions. Its calculation was described in Section 1.1.1.8.

CEMI can be determined for any value of n ranging from 1 to maximum set by the number of interruptions experienced by the most interrupted customer on the system.

3.2.2 Benefits

The benefits of collecting data and reporting on CEMI have been recognized by a growing number of utilities. The two primary benefits relate to an understanding of the distribution of the frequency of interruptions among the more frequently interrupted customers and its relation to customer satisfaction.

As stated previously, utilities have recognized the potential disconnect between the SAIFI and SAIDI and the level of customer satisfaction. This is chiefly because the customer satisfaction is typically non-linear with dissatisfaction triggered after the customer experiences a certain number of outages. While studies have shown that such triggering number of outages can differ from jurisdiction to jurisdiction and between rural and urban areas, it is possible to find the applicable threshold and calculate CEMI for such number of outages. The resulting CEMI will correlate well with customer satisfaction levels.


When used to trigger the expenditure (or provide regulatory feedback), CEMI will direct the investment towards areas experiencing less reliability and hence serves well the objective of equalizing the reliability to customers in different regions.

By preferring CEMI for different values of n , valuable insight can be obtained into distribution of customer experience with reliability of power delivery.

It should be appreciated that CEMI is a strictly frequency based index and reduction in outage duration without reduction in outage frequency will not reduce CEMI.

Furthermore, CEMI is not sensitive to improvements that do not lead to crossing the n interruptions per year. For example, in the case of $CEMI_4$, an

FIGURE 1: Percentage of Multiple Interruptions (CEMI_n)

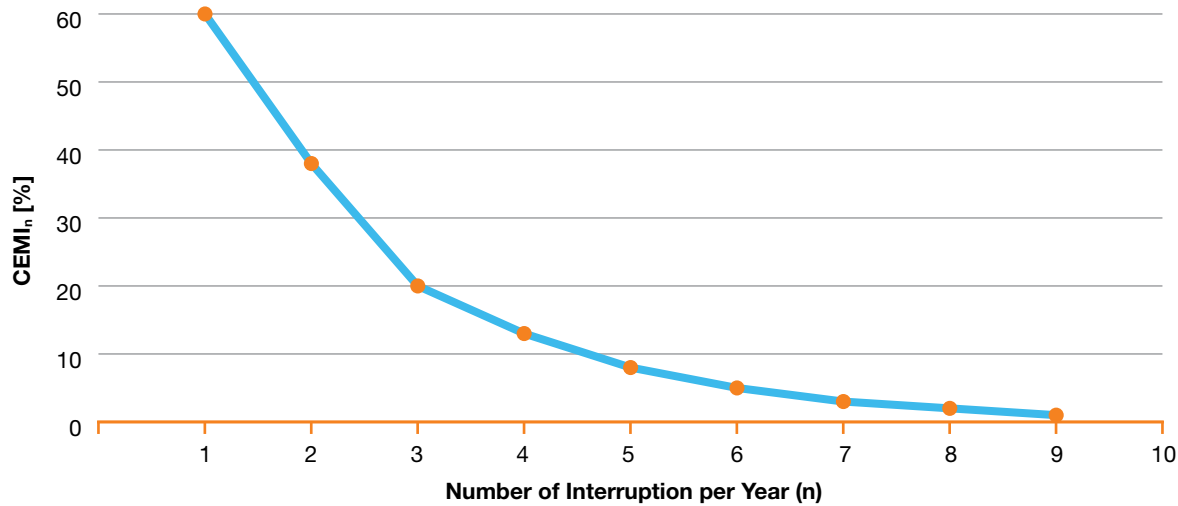

improvement in reliability that results from a reduction of the number of outages on a given feeder from 10 to 5 will not register in CEMI₄. Selection of n for calculation of CEMI_n is consequently very important and should reflect the maximum acceptable number of interruptions for customer per year. One of the risks of using CEMI to allocate expenditures without proper consideration to SAIFI and SAIDI is that emphasis may be put on improving feeders that will achieve a jump from “over n” to “under n” and hence register in CEMI, as opposed to focusing on worst performing feeders that may be impossible or impractical to improve upon to the point of falling below n interruptions per year.

In summary, CEMI is a valuable complimentary index to SAIFI and SAIDI which helps to show the extent of presence of feeders with unsatisfactory performance. This benefit can be further increased by reporting CEMI_n for several values of n as shown in the figure below. If CEMI_n is reported for only one value of n, great care has to be exercised when selecting the value since it will be directly tied to the strategic target for the reduction of the number of interruptions seen by customers.

3.2.3 Data Collection Requirements and Incremental Effort

CEMI_n data collection requirements are similar to that of SAIFI except that the identity of the interrupted customers has to be retained in the collection system to determine which customers were interrupted over the reporting period and how many times. The requirement to record the number of interruptions for each customer at least once represents additional data collection demand above and beyond that required for CAIFI. With the proliferation of CIS and its connectivity to the reliability data collection systems, this requirement is not prohibitive since the information will be readily available and only a programming change will be required. Recording the number of interruptions for each customer would be preferable over recording by feeder or segment of a feeder since the former system could accommodate customer relocations and other system changes.



4 Experience of Different Jurisdictions

This section summarizes the experience of calculating and reporting reliability indices from different jurisdictions. It is intended to be representative rather than exhaustive.

4.1 Summary

By far, the indices most commonly used and reported by the utilities are SAIFI and SAIDI. Many utilities also report CAIDI; some explicitly and some implicitly by pointing to the formula used to calculate CAIDI from SAIFI and SAIDI.

Relatively few utilities are presently calculating CEMI and even fewer are reporting it. Those who do point to the significant benefit obtained from a better understanding of issues pertaining to poorly

performing feeders. In addition, there is a significant improvement understanding the ranges of outage magnitudes to location and sources of outages.

As noted by one of the reporting utilities: *It was difficult to accept that with a system SAIFI of less than 1.5, greater than 20,000 customers had experienced more than six interruptions.*

Relatively few utilities are currently reporting CAIFI. All utilities that report CAIFI and/or CEMI also report basic indices such as SAIFI, SAIDI and CAIDI.

Typically, utilities that report CAIFI and/or CEMI reported on more indices, indicating that their data collection is closely tied to their Customer Information Systems. They also had the ability to distinguish exactly which customers were affected by each outage and determine what characteristics these customers had that differed from others.

In most cases, the reported indices coincide with those ordered by the corresponding regulatory body. For example, most regulators are requesting SAIFI and SAIDI as a part of the score card from all distribution companies within their jurisdiction, ensuring consistency in calculation methodology within each jurisdiction. However, such consistency is not maintained between jurisdictions.

Reliability indices are often used by regulators to impose performance targets for utilities. In some cases, these are tied to incentives and penalties, such as within the Performance Based Regulation (PBR) frameworks. Furthermore, reliability indices calculated on a per customer or per feeder basis are sometimes used to determine the financial compensation offered to customers if the power supply fails to perform up to applicable minimum standard.

4.2 Canadian Experience

Reliability indices calculated and reported in Canada are shown in Table 1. Canada is unique compared to the United States and other countries, as the Canadian Electricity Association (CEA) has been collecting distribution reliability performance data on behalf of its member utilities for over 20 years. The data reported includes:

- System Average Interruption Frequency Index (SAIFI)
- System Average Interruption Duration Index (SAIDI)

- Customer Average Interruption Duration Index (CAIDI)
- Index of Reliability (IOR)
- Customer interruptions per kilometer
- Customer hours per kilometer

The results are reported to member utilities and aggregate values are available to the public at a cost.

In addition, the utilities typically either report the reliability indices to their respective regulatory agencies, include them in annual or other performance reports, or post them on line.

Most of the utilities/jurisdictions are reporting SAIFI and SAIDI indices.

BC Hydro has one of the most detailed reporting systems and is the only utility reporting CEMI₄ both to the regulators and on line. The British Columbia Utilities Commission is expecting BC Hydro to produce SAIFI, SAIDI, CAIDI, ASAI, SARI and MAIFI. BC Hydro has chosen to report on CEMI₄ in addition to the regulator's requirements.

The Ontario Energy Board publishes Electricity Reporting & Record Keeping Requirement (RRR) specific reliability indices that are to be collected and reported by Ontario distribution utilities. These include SAIDI, SAIFI, CAIDI and MAIFI. However, distributors that do not have system capabilities enabling them to capture or measure MAIFI are exempted from this reporting requirement.

Alberta Utilities Commission (AUC) Rule002 specifies the requirement for distribution utilities to report SAIDI and SAIFI in the province. AUC also defines the maximum SAIFI and SAIDI for each distribution company subject to Rule002. This differs between utilities.

Other Canadian jurisdictions have similar requirements.

TABLE 1: Representative example of reliability indices collected by Canadian Utilities

Province	Utility	
British Columbia	BC Hydro	SAIFI, SAIDI, CAIDI, ASAI, SARI, CEMI ₄
	Fortis BC	SAIFI, SAIDI
Alberta	AUC	SAIFI, SAIDI
	Enmax	SAIFI, SAIDI
	EPCOR	SAIFI, SAIDI
	Fortis Alberta	SAIFI, SAIDI
	ATCO Electric	SAIFI, SAIDI, CAIDI
Saskatchewan	SaskPower	SAIFI, SAIDI
Manitoba	Manitoba Hydro	SAIFI, SAIDI, CAIDI, Availability
Ontario	Ontario Energy Board	SAIFI, SAIDI, CAIDI, MAIFI
	Toronto Hydro	SAIFI, SAIDI, CAIDI
	Hydro Ottawa	SAIFI, SAIDI
	Hydro One	SAIFI, SAIDI, CAIDI
Quebec	Hydro Quebec	SAIFI, SAIDI
Nova Scotia	Nova Scotia Power	SAIFI, SAIDI
New Brunswick	New Brunswick Power	SAIFI, SAIDI
Newfoundland	Newfoundland and Labrador Hydro	SAIFI, SAIDI

4.3 USA Experience

The indices reported by US utilities are summarized below.

With few exceptions, the indices reported are those ordered by the corresponding regulatory body. Consequently, the reported indices are often the same within the state. A number of exceptions apply, most notably in Florida, where smaller utilities are not required to produce the indices that would require significant additional effort and/or upgrade of CIS, such as CEMI.

It should be emphasized that the reported indices are not necessarily calculated the same way and that many utilities produce several versions of the same indices, such as coastal vs. inland for maritime utilities, worst feeder vs. average etc.

DC's Pepco calculates multiple CEMI's, e.g. CEMI₈, CEMI₆ and CEMI₃, which correspond to more than 8, 6 and 3 interruptions per year.

The Delaware Public Service Commission has ordered collection and reporting of CEMI for 8 or more interruptions (CEMI₈).

The Florida Public Service Commission has ordered and is reporting detailed statistics which include CEMI for 6 or more interruptions (CEMI₆). Utilities with fewer than 50,000 customers are presently exempt from the reporting requirements.

PacifiCorp, one of the Western United States leading utilities, is reporting CEMI-based statistics the show the range of interruptions between the two limits ranging from 0 to 30 in seven categories. PacifiCorp also displays the information graphically, where each category is represented by a different color on a map to show regions or feeders with higher and lower reliability.

The state of Illinois is reporting CAIFI in addition to SAIFI. Missouri is also reporting CAIFI in addition to SAIFI.

TABLE 2: Representative example of reliability indices collected by US utilities

State/Utility	Indices Reported
Alabama	SAIFI, SAIDI, CAIDI, MAIFI
California (CPUC)	SAIDI, SAIFI, MAIFI
Colorado	SAIFI, SAIDI, CAIDI
Connecticut	SAIFI, SAIDI
D.C. (Pepco)	SAIDI, SAIFI, CAIDI, CEMI ₈ , CELID ₈
Delaware	SAIDI, SAIFI, CAIDI, CEMI ₈ , CELID ₈
Florida	SAIDI, SAIFI, CAIDI, MAIFI, CEMI ₅
Georgia	SAIFI, SAIDI, CAIDI
Hawaii	SAIFI, SAIDI, CAIDI
Idaho (PacifiCorp)	SAIFI, SAIDI, CEMI
Illinois	SAIFI, CAIFI, CAIDI
Indiana	SAIFI, SAIDI, CAIDI

continued

State/Utility	Indices Reported
Iowa	SAIFI, SAIDI, CAIDI
Kansas	SAIFI, SAIDI, CAIDI
Kentucky	SAIFI, SAIDI, CAIDI
Louisiana	SAIDI, SAIFI
Maine	SAIFI, CAIDI
Maryland	SAIFI, SAIDI, CAIDI
Massachusetts	SAIFI, SAIDI
Minnesota	SAIFI, SAIDI, CAIDI
Missouri	SAIFI, SAIDI, CAIDI, CAIFI
Nevada	SAIFI, SAIDI, CAIDI, MAIFI
New Jersey	SAIFI, CAIDI
New Mexico	SAIFI, SAIDI, CAIDI, ASAI
New York	SAIFI, CAIDI
North Dakota	SAIFI, SAIDI
Ohio	SAIFI, SAIDI, CAIDI, ASAI
Oklahoma	SAIFI, SAIDI, MAIFI
Oregon	SAIFI, SAIDI, CAIDI, MAIFI
Pennsylvania	SAIFI, SAIDI, CAIDI, MAIFI
Rhode Island	SAIFI, SAIDI
Texas	SAIFI, SAIDI
Utah	SAIFI, SAIDI
Vermont	SAIFI, CAIDI
Virginia	SAIFI, SAIDI, CAIDI
Washington	SAIFI, SAIDI, CAIDI, MAIFI, CEMI
Wisconsin	SAIFI, SAIDI, CAIDI

4.4 Europe Experience

A range of indicators are used in different countries across the globe. SAIFI and SAIDI remain as the basic calculated and reported indicators, albeit often under different names (due to non-English speaking countries). Different methods are often used to weigh the interruptions, which makes it difficult to directly compare results. Weighting by demand, consumption, contracted demand or other entities reflecting the customer size typically biases the results towards larger industrial and commercial customers who are often supplied from more reliable urban feeders. Weighting by distribution transformers leads to bias towards smaller transformers and hence towards rural customers, as they are typically supplied from smaller transformers.

Indices that outline ENS and others that indicate the magnitude of unsupplied energy correlate better with the financial consequences of outages than the indices that treat each service equally, irrespective

of size. However, the ENS will always be an approximation, since the demand during the outage can only be estimated.

Norway and Slovenia are using the CAIFI index in addition to SAIFI and SAIDI, reporting information about the number of interruptions experienced by those customers that actually get interrupted.

Sweden appears to be the only jurisdiction that calculates and uses the CEMI index. In fact, Sweden has upgraded its CIS after 2010 to include interruption information for each unique customer. This allows it to calculate just about any of the indices discussed in this White Paper.

A number of countries are using penalties or incentives in their regulatory regimes that are based on the reported reliability indices. Several countries even offer compensation to customers whose reliability indices are not met. The discussion of such schemes falls outside the scope of this White Paper.

TABLE 3: Representative example of reliability indices collected by European utilities

Country	Indices Reported
Austria	SAIDI, SAIFI, ASIDI, ASIFI, CAIDI, (CML, ENS)
Bulgaria	SAIDI, SAIFI
Cyprus	SAIDI, SAIFI,
Czech Republic	SAIFI, SAIDI, CAIDI, CENELEC
Denmark	SAIDI, SAIFI, ENS
Estonia	SAIDI, SAIFI, CAIDI, total annual interruption time for each customer
Finland	SAIDI and SAIFI
France	SAIFI, SAIDI, MAIFI, Percentage of customer with “insufficient” quality of supply
Germany	SAIDI (LV), ASIDI (MV), SAIFI
Great Britain	Customer Interruptions (CI) and Customer Minutes Lost (CML)
Greece	SAIFI, SAIDI

continued

Country	Indices Reported
Hungary	SAIFI, SAIDI, CAIDI, MAIFI
Ireland	Customer Interruptions (CI) and Customer Minutes Lost (CML)
Italy	SAIFI, SAIDI, MAIFIE
Lithuania	SAIDI, SAIFI (calculated for both long and momentary)
The Netherlands	SAIDI, SAIFI, CAIDI (calculated for both long and momentary)
Norway	SAIFI, SAIDI, CAIDI, CTAIDI, CAIFI
Poland	SAIFI, SAIDI, MAIFI
Portugal	SAIFI, SAIDI, ENS, AIT, MAIFI
Romania	SAIFI, SAIDI, ENS, AIT
Slovakia	Average Time of Interruption
Slovenia	SAIDI, SAIFI, CAIDI, CAIFI, MAIFI
Spain	TIEPI, NIEPI
Sweden	SAIFI, SAIDI, CEMI, ENS, MAIFIE

4.5 Australian Experience

Reliability indices calculated and reported in Australia consist almost exclusively of SAIFI and SAIDI. These indices are embedded in the regulatory regime in each jurisdiction. While the methodology for calculation differs between jurisdictions, the indices are used almost universally to define minimum acceptable standards. This is because the basis for the use of the indices is in the National Electricity Rules (NER). The NER contains a reliability incentive mechanism called the Service Target Performance Incentive Scheme, or STPIS. It provides for incentive arrangements under which reliability performance is measured using standard metrics (for example, SAIDI), and distributors receive a financial bonus for exceeding reliability targets. Alternatively, they are penalized if they miss the targets. The Rules can be superseded by the applicable electrical code or local regulatory body.

For example, in Tasmania, the target SAIDI and SAIFI are set by Tasmanian Electricity Code and differ by location.

In New South Wales (NSW), the reliability standard is set out by distributor's license. The license sets SAIFI and SAIDI that differ by location. The license defines the minimum acceptable levels and provides for payments to customers whose minimum guaranteed reliability levels are not met.

In Queensland, the distribution reliability regulations are set out in the Queensland Electricity Code. It sets minimum reliability standards in terms of SAIDI and SAIFI, which differ for different feeder types. Distributors must use best endeavors to ensure that the minimum standards are met. The code also sets the minimum acceptable levels and provides for customers being compensated if these levels are not met.

TABLE 4: Representative example of reliability indices collected by Australian utilities

Jurisdiction	Indices Reported
ACT (Australia Capital Territory)	SAIFI, SAIDI, CAIDI
New South Wales	SAIFI, SAIDI (average and for each feeder)
Queensland	SAIFI, SAIDI
South Australia	SAIDI, SAIFI, maximum time to restore supply
Tasmania	SAIFI, SAIDI
Victoria	SAIFI, SAIDI, MAIFI
Western Australia	SAIFI, SAIDI

Conclusion

Presently, the most used distribution reliability indices are SAIFI, SAIDI, CAIDI and to a lesser extent MAIFI.

While these indices provide very good indications of the reliability of the distribution system as a whole, they do not provide any information about frequency of outages on poorly performing feeders. Such frequency can be orders of magnitude higher than the overall SAIFI, yet the overall SAIFI may not be significantly affected. Worse still, improvement in performance of the poorest performing feeders may not show in SAIFI and SAIDI at all, since any movement may be smaller than the natural variability of those indices from year to year.

Some jurisdictions address this issue by reporting performance of the worst feeder. In extreme cases, utilities can report performance of each individual feeder, but this approach results in large amounts of data and makes it difficult to compare year to year results. This makes meaningful trending challenging.

In conjunction with basic indices such as SAIFI and SAIDI, CAIFI, and CEMI in particular, address this problem well.

The selection of “n”, the triggering number of interruptions in $CEMI_n$, is critical. The value should reflect the maximum number of interruptions customers are willing to accept without expressing dissatisfaction. The values used can differ from 3 to 8. Another approach is to show a histogram of CEMI for each different n, or show this information graphically on a topographical map for each distribution area. Such use is still practical for trending while conveying significantly more information than $CEMI_n$ calculated for single n.

Calculation of CAIFI and CEMI typically requires the modification of existing data collection since the information about the number of outages for each customer (or feeder block) has to be stored. However, for any utility capable of calculating customer based indices, such modification represents only a programing change.

Utilities that choose to move ahead with recording data for CAIFI and CEMI will need to investigate the impacts to their reporting systems. Moving into the 21st century, new technology and measures will facilitate the improvement of reliability for all utility customers.



